





A **single control panel** to manage
all your **FOGGING SYSTEMS**
from smartphones, computers and tablets





GENERAL CONTROL OF ALL SYSTEMS

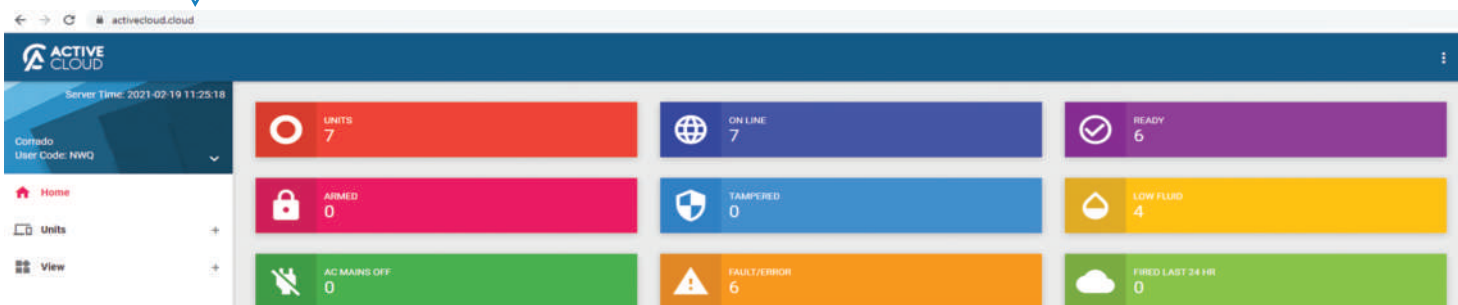

SECURE AES128 encrypted communication

REMOTE DEVICE ASSISTANCE analytical control of all features and real-time system diagnostics

WIFI & LAN WIRED on the same card



-  Total number of managed systems
-  N. systems connected to the Cloud
-  N. ready-to-shoot systems
-  N. armed systems
-  N. tampered systems
-  N. systems with low fluid quantities
-  N. battery-powered systems in the absence of AC network
-  N. systems with error reporting
-  N. systems that have shot in the last 24 hours

LIST OF SYSTEMS WITH INDIVIDUAL CONTROL OPTIONS

Server Time: 2021-02-19 11:27:22

Cortado
User Code: NWQ

Home
Units
View

Units

All units

Urifog

ActiveCloud Test Pump 250

M200

M300

M800

M500

M400

User Units

Refreshed: 2021-02-19 12:28:49

Show: 10 entries

Search:

Unit ID	Name	Type	Firmware Version	Owner	Role	Last Update	Actions
001460	Urifog	MODULAR 200	1.1.0/A03 (Update)	Gianluca	Full control	2021-02-19 12:25:32	   
002265	ActiveCloud Test Pump 250	PUMP-250	1.1.0/A02 (Update)	Giampaolo	Full control	2021-02-19 12:25:21	   
005329	M200	MODULAR 200	1.1.0/A03 (Update)	Gianluca	Full control	2021-02-19 12:25:20	   
005337	M300	MODULAR 300	1.1.0/A03 (Update)	Gianluca	Full control	2021-02-19 12:26:34	   
005340	M800	MODULAR 800	1.1.0/A03 (Update)	Gianluca	Full control	2021-02-19 12:25:37	   
005346	M500	MODULAR 500	1.1.0/A03 (Update)	Gianluca	Full control	2021-02-19 12:26:29	   
005349	M400	MODULAR 400	1.1.0/A03 (Update)	Gianluca	Full control	2021-02-19 12:24:59	   

Showing 1 to 7 of 7 entries

Add New

Dashboard
Single System Control
Panel

System
Refresh

Setting
parameters
and information

Remove
Delete the system



CONTROL OF THE INDIVIDUAL SYSTEM



Server Time: 2021-02-19 09:04:52

Corrado
User Code: NWQ

Home

Units

All units

> Urfog

ActiveCloud Test Pump 250

M200

M300

M800

M500

M400

View

Urfog

Unit ID	Type	Owner	Rights	Firmware Version	Shot time
001460	MODULAR 200	Gianluca	Full control	1.1.0/AD3 (Update)	4 sec

CONNECTION Online

DEVICE OK

READY YES

LAST UPDATE 2021-02-19 10:04:13

TAMPER N/A

FLUID 100 %

AC MAINS OK

BOS. TEMP 410 °C

ARMED NO

SHOTS NUM 35

LAST SHOT N/A

DIAGNOSTIC 100

Actions

ARM

TANK RESET

SHOOT

TEST SHOT

© 2020 ActiveCloud
Version: 1.3.2



FLUID CONTROL AND BAG RESET

Signaling of systems where the fluid level is exhausted or in reserve



REMOTELY ARMAMENT AND SHOOTING



SHOOTING VERIFICATION TEST



Armament and shooting controls of multiple systems at the same time



CONFIGURING INDIVIDUAL SYSTEM DATA AND INFORMATION

Server Time: 2021-02-19 11:30:36

Corrado
User Code: NWQ

Home

Units

All units

> Urfog

ActiveCloud Test Pump 250

M200

M300

M800

M500

M400

View

Unit 001460 Settings

Urfog

Home Details Shooting Alarms

Unit Name Urfog

Unit Owner OXH-06

SAVE

Managed by

User Id	Name	Role
EDW-1	Giampaolo	Full control
FWS-5	Daniilo	Full control
NWQ-8	Corrado	Full control


User Code

View Maintenance Full control

Monitoring | Maintenance | Complete control

MULTI-LEVEL SYSTEM

It is possible to authorize users individually with different permissions for the management and/or control of the systems



CONTROL OF THE **INDIVIDUAL SYSTEM**



CONFIGURING INDIVIDUAL SYSTEM DATA AND INFORMATION

Unit 001460 Settings

Urfog

Home Details Shooting Alarms

Installation Address

Via Toscana, 38 - 10099 - San Mauro T.se

Contact

Sig. Corrado

Telephone Number

+39.011.0133037

Other Details

SAVE



Details

Installation address,
reference person,
phone and
system insights

Unit 001460 Settings

Urfog

Home Details Shooting Alarms

Shooting Time

4

SAVE

Shooting
Setting
shooting time
in seconds

Unit 001460 Settings

Urfog

Home Details Shooting Alarms

Email 1

pipon@pipon.com

Email 2

pluto@pluto.com

Email 3

paperno@paperno.com

Events

Select for which events (status change) you want receive an email notification.

Connection ☐ ON ☐ OFF

Ready ☐ ON ☐ OFF

Armed ☐ ON ☐ OFF

Tempered ☐ ON ☐ OFF

Empty Tank ☐ ON ☐ OFF

Fault/Error ☐ ON ☐ OFF

AC Mains ☐ ON ☐ OFF

Shot ☐ ON

SAVE

X

Alarm

E-MAIL ALERTS

Insertion of up to 3 addresses
and selection
of warning options
to associate



Developer APIs available

Ability to develop
customized
connectivity solutions
for integrating
UR FOG systems
into pre-existing intranets
(banks, regulators, etc.)

Unit 001460 Log Events

Refreshed: 2021-02-10 11:32:18

Show 25 entries

Time	Event
2021-02-11 13:59:53	send command "get_status" (00H-0657-FJBJ)
2021-02-10 12:18:46	setfdiag = 256
2021-02-10 12:15:49	ready = 1
2021-02-10 12:14:59	ready = 0
2021-02-10 12:14:59	setfdiag = 0
2021-02-10 11:41:24	setfdiag = 256
2021-02-10 11:38:27	ready = 1
2021-02-10 11:37:36	ready = 0
2021-02-10 11:33:26	ready = 1
2021-02-10 11:32:35	setfdiag = 0
2021-02-10 11:32:35	ready = 0



Log Events

System Registration
500 Events/Commandse



Installable on all
UR FOG
fogging systems



UR FOG
SECURITY FOGGING SYSTEMS

UR FOG S.r.l.

Via Toscana 38 - 10099 San Mauro T.se (Turin) Italy

Tel. +39 011 0133037 | www.urfog.com | info@urfog.com